





# Configuration Options 1800 Series



## 1. Through the Wall

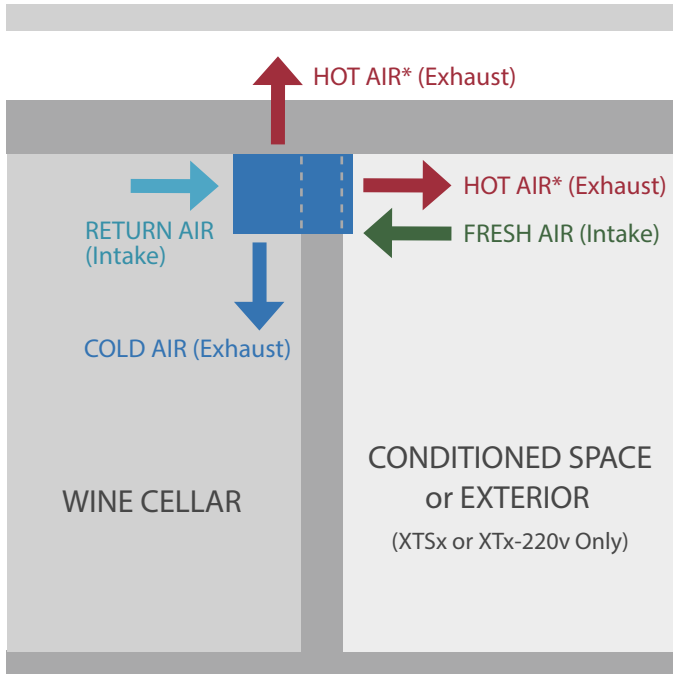

## 2. Above the Cellar

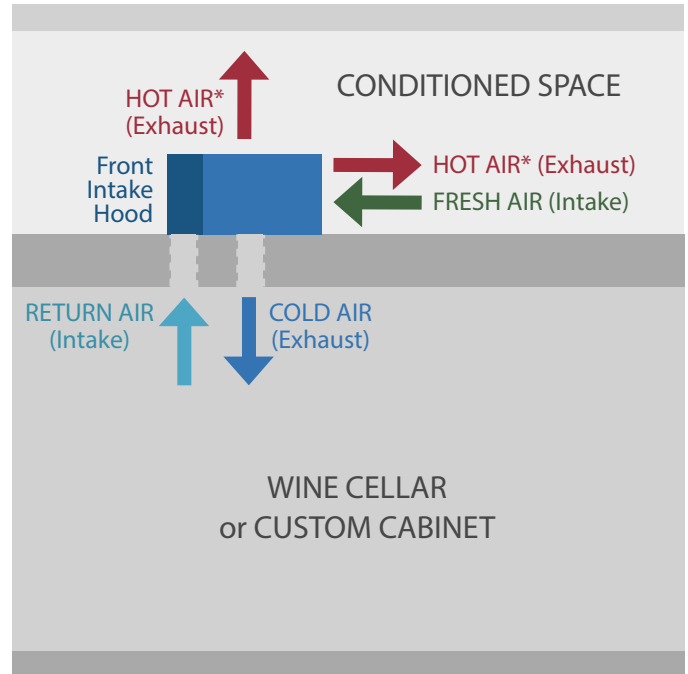

## 3. Rear Ducted

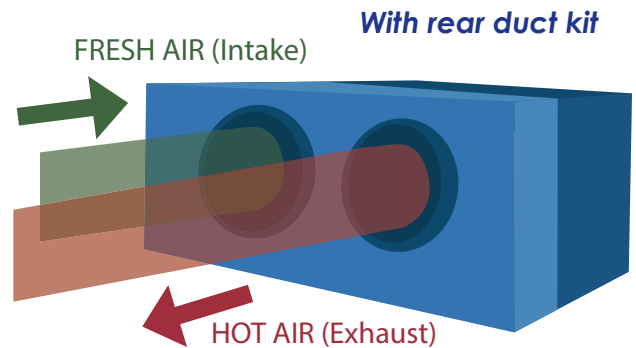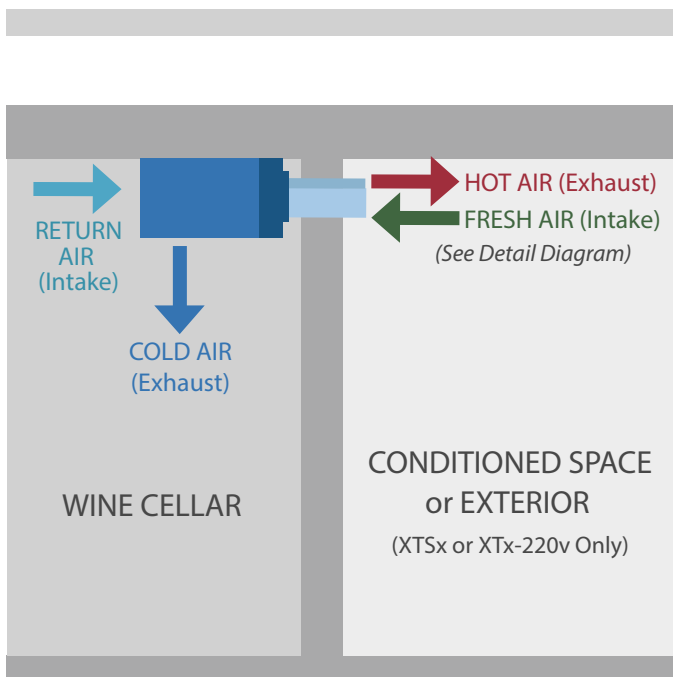

**Summary:** The diagrams above show the different ways in which CellarPro 1800 cooling units can be installed and configured.

- The front **cannot** be ducted except as shown with the addition of our **front intake hood**.
- The rear **cannot** be located inside the cellar, unless the cooling unit is installed with our **rear duct kit**, so that the fresh air comes from **outside** the cellar and the exhaust goes **outside** the cellar.
- The rear can be ducted with our **rear duct kit**, so that the fresh air comes from **outside** the cellar and the exhaust goes **outside** the cellar.
- IF THE REAR IS DUCTED, AN AUXILIARY FAN **MUST ALWAYS BE USED** TO AUGMENT THE AIRFLOW OF THE HOT AIR INTAKE/EXHAUST. OUR DUCT KIT INCLUDES AN INLINE AUX FAN AND SWITCHED POWER FOR THE FAN.

\* The hot air exhaust can be rear or top vented.